


AD-320 Specifications			
5VNCMFS \$BQBBDJUZ	ESZ XFJHIU		MCT
5VNCMFS %JBNFUFS		DN	
5VNCMFS %FQUI		DN	
5VNCMFS 7PMVNF	DV GU		-
5VNCMFS %SJWF .PUPS	IQ	L8	
#MPXFS 'BO .PUPS	/ "		
%PPS 0QFOJOH EJBNUFS	w	DN	
%PPS 4JMF	w	DN	
4 " ' & 8BUFS \$POOFDUJPO	/)	' / 1 5	
%SZFST QFS	\$POUBJOFS		
%SZFST QFS	5V DL		
8JEUI	w	DN	
%FQU	w	DN	
)FJHIU	w	DN	
Airflow			
HBT FMFDUSJD TUFBN	DGN	DNN	
&YIBVTU \$POOFDUJPO	w	DN	
(" 4 .0% & -	7PMUBHF	WBJMBCMF	X
	"QQSPY	/FU	LH
	"QQSPY	4IJQ	LH
)FBU *OQVU	QFS	LDBM IS
	*OMFU 1JQF	\$POOFDUJPO	
		w # 4	
& - \$53 * \$.0% & -	7PMUBHF	WBJMBCMF	W
	"QQSPY	/FU	LH
	"QQSPY	4IJQ	LH
45 & " .0% & -	7PMUBHF	WBJMBCMF	X
	"QQSPY	/FU	LH
	"QQSPY	4IJQ	LH
	4UFBN \$POTVNQUJPO	QFS	CBS
	0QFSBUJOH 4UFBN	\$PNQSFTTTE	DNI
	\$PNQSFTTTE	"JS	
	#PJMFS)PSTFQPXS	4VQQMZ \$POOFDUJPO	
	3FUVSO \$POOFDUJPO		

Specifications in parentheses are metric equivalents.
 *Dryer must be provided with clean, dry and regulated
 80 psi +/- 10 psi (5.51 bar +/- 0.69 bar) air supply.

4/20/10

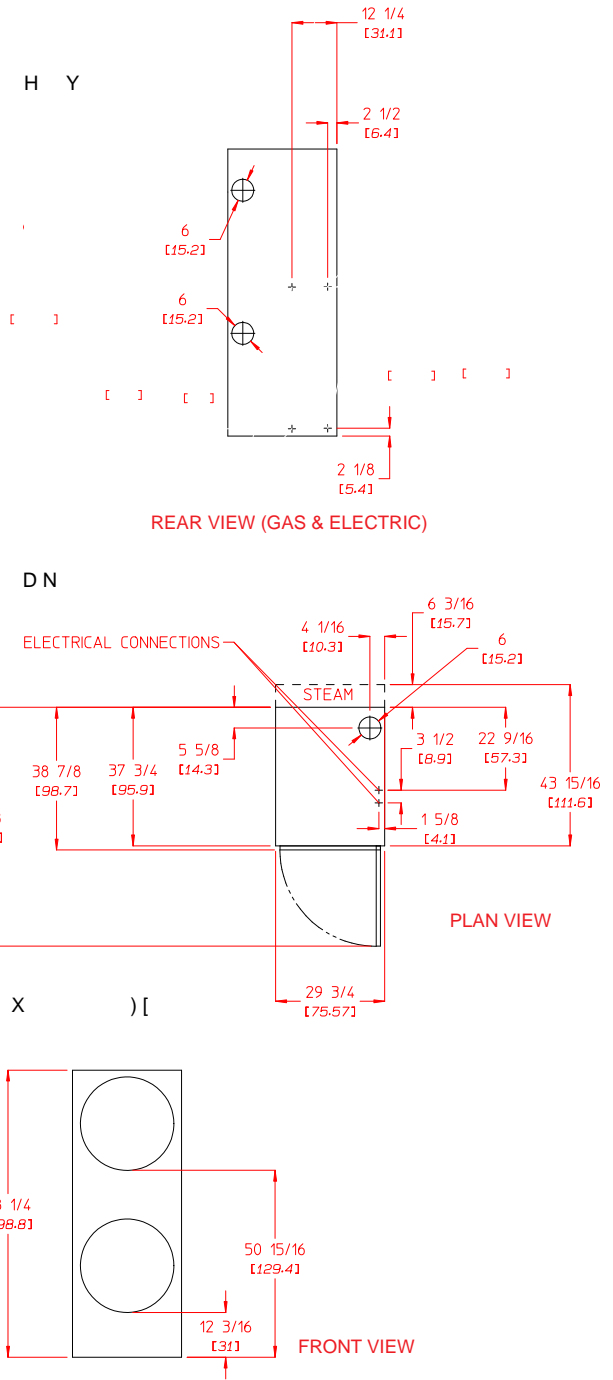

Electrical Service Specifications						
GAS & STEAM						
SERVICE VOLTAGE	PHASE	WIRE SERVICE	OVEN KW	APPROX AMP DRAW		CIRCUIT BREAKER
				60 Hz	50 Hz	
100	1ø	2	--	7.8	8.0	15
115	1ø	2	--	7.8	--	15
208	1ø	2	--	4.8	--	15
220	1ø	2	--	--	3.6	15
240	1ø	2	--	4.4	4.3	15

Electrical Service Specifications						
ELECTRIC						
SERVICE VOLTAGE	PHASE	WIRE SERVICE	OVEN KW	APPROX AMP DRAW		CIRCUIT BREAKER
				60 Hz	50 Hz	
208	1ø	2	15	76.9	--	110
240	1ø	2	15	66.9	66.8	90
208	3ø	3	15	46.4	--	70
220	3ø	3	15	--	43.7	60
240	3ø	3	15	40.5	40.4	60
380-440	3ø	4*	15	--	27.1	45
416	3ø	4*	15	--	25.1	45
480	3ø	3	15	23.1	--	45

